


Reno County Water Supply Requirements

Siting, Construction and Administrative Requirements according to the Reno County Sanitation Code

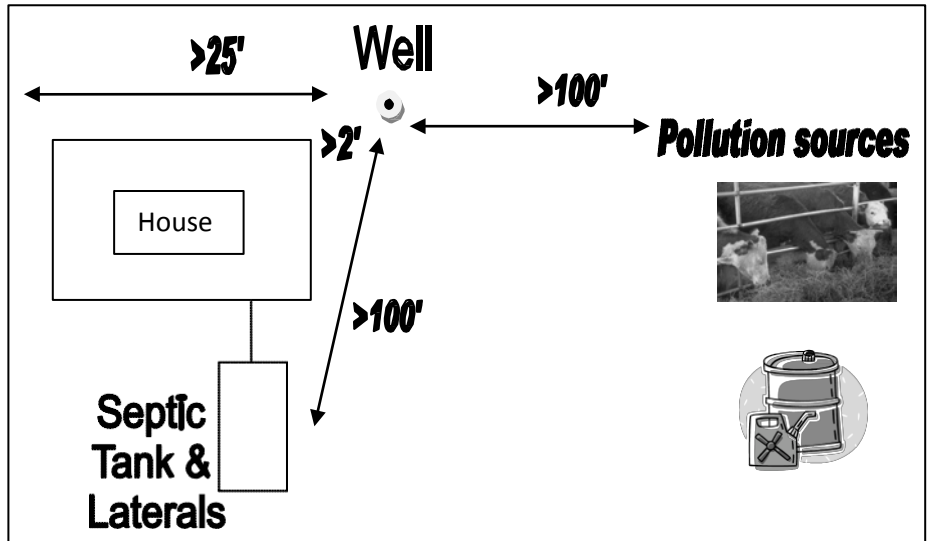

Siting Requirements

1. Well at least 25 feet from any property line.
2. Adequate drainage within 50 feet of well.
3. Well at least 2 feet from any pit or building.
4. Well at least 10 feet from any watertight sewer line.
5. Well at least 100 feet from any potential pollution source. Such as, but not limited to:
 - i. Wastewater system.
 - ii. Petroleum storage.
 - iii. Confined animal feedlot.

Construction Requirements

1. Well casing extends at least 1 foot above surface grade.
2. Sanitary seal well cap installed.
3. Approved well vent installed.
4. Conduit used for submersible pump applications.
5. Annular space of the well filled from 3 to 23 feet below surface grade with an approved grout. (Grout to water table if less than 23 feet from surface grade.)
6. Backflow prevention used on livestock and irrigation wells meeting the definition of a private water supply.

Administrative Requirements

1. Prior to drilling, contact the Health Dept. for a site evaluation.
2. Pay \$175 permit fee to the Health Dept. (*Fee doubles if not paid prior to installation.*)
3. A trip charge of \$50 will be applied on the 3rd visit & each visit thereafter.
4. Provide Health Dept. a copy of the State of Kansas WWC-5, (well log) form which your well driller is required to complete and provide you with a copy.
5. Verification that Property Owner or Water Well Contractor completed well casing or alterations and connection of pitless adapter.
6. Contact the Health Dept. upon completion of the well.